

www.heatlinkgroup.com

StatLink® Controls c/w Tie-In to Indoor/Outdoor Controller

July 8, 2008 - **ELECT 5.2**

Application: **StatLink® controls activating individual manifold module actuators and automatic mixing valve reset controller which in turn activates boiler plus primary (P-2) and system (P-1) pumps. DHW tank aquastat opens DHW valve and activates boiler plus primary (P-2) and system (P-3) pumps.**

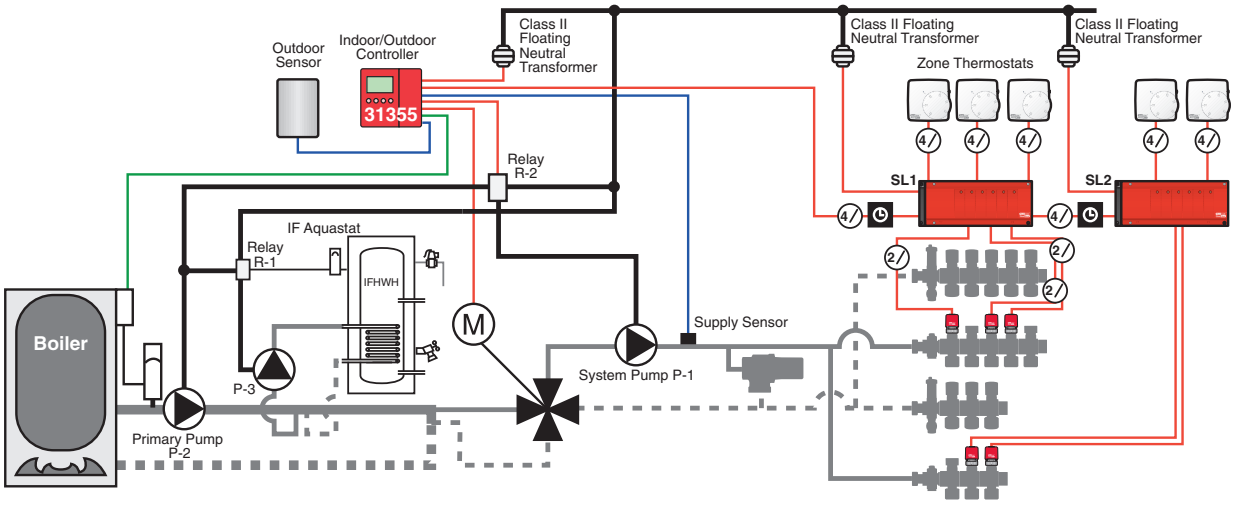

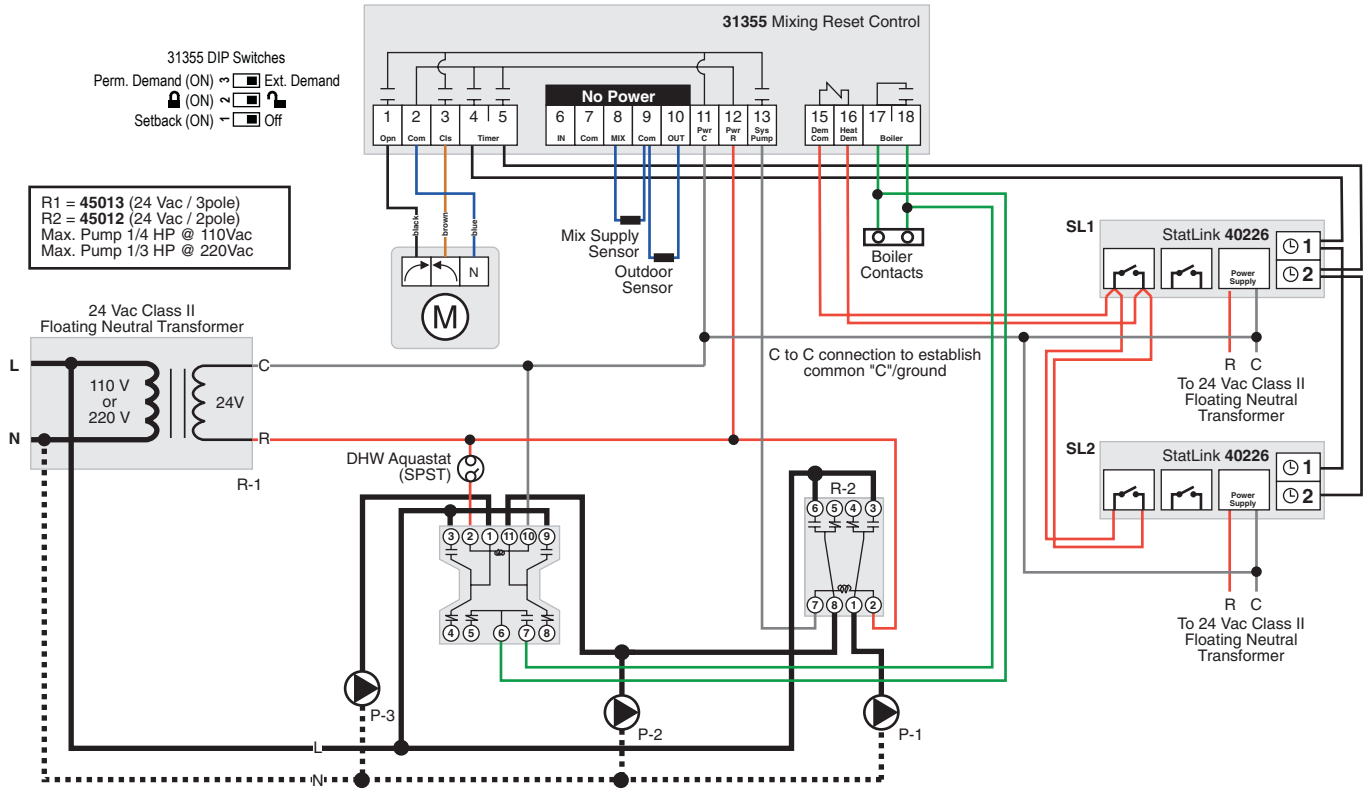

Note:

- Drawings are for HeatLink® suggested electrical schematics only! User must determine if electrical schematic will work for their particular application. User must also confirm all HeatLink® schematics with manufacturer schematics of each particular control chosen.
- In all cases manufacturer equipment schematics will take precedence over HeatLink® electrical schematics.
- All wiring as per applicable electrical codes!