
www.heatlinkgroup.com

StatLink® Controls Activating Circuits plus Snowmelt. Controller

September 23, 2008 - **ELECT 5.4a**

Application: **StatLink® controls activate the mixing valve control for the low temp. circuit which in turn activates the boiler and primary (P-5) and system (P-1) pumps. Snowmelt controller activates the boiler and primary (P-5), heat exchanger (P-2) and system (P-3) pumps. For high temp. fan coil/DHW/pool circuit StatLink® controls activate the boiler, primary (P-5) and system (P-4) pumps.**

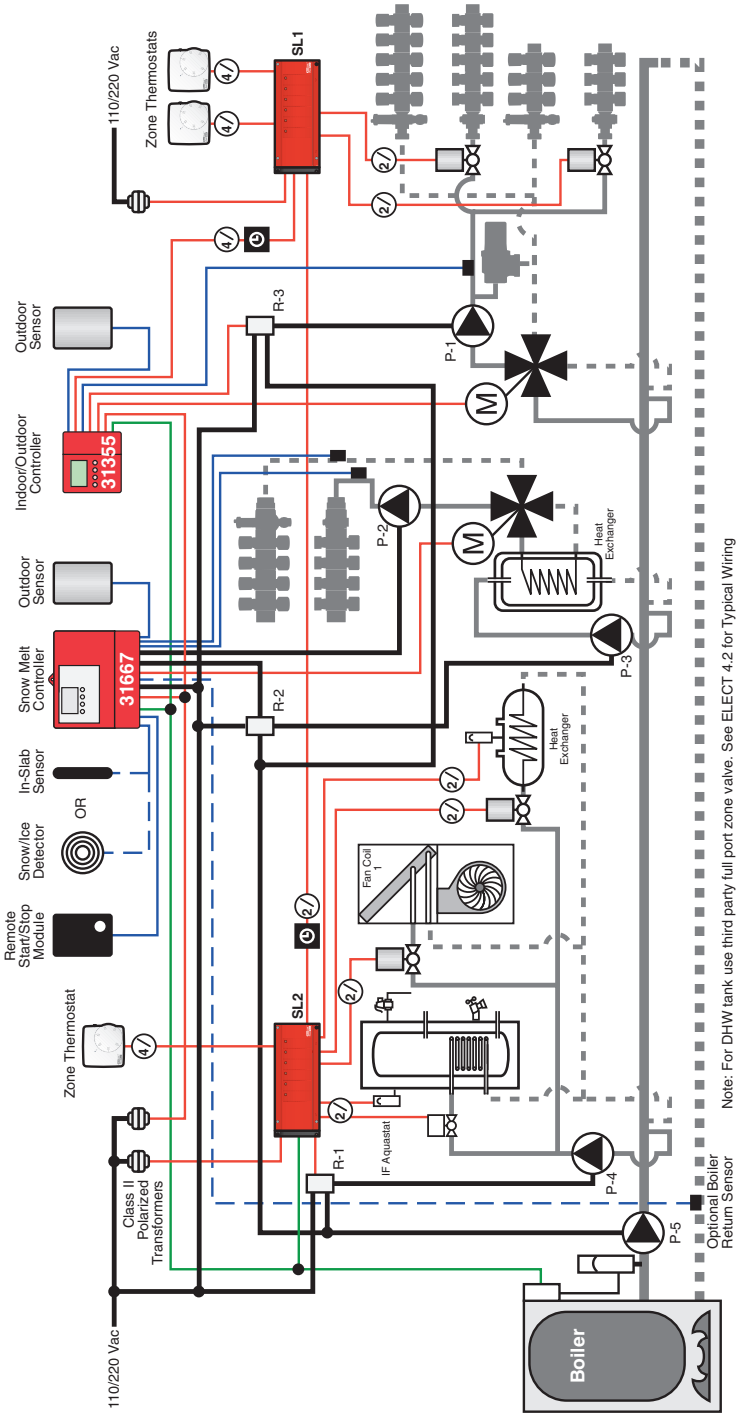

Note:

- Drawings are for HeatLink® suggested electrical schematics only! User must determine if electrical schematic will work for their particular application. User must also confirm all HeatLink® schematics with manufacturer schematics of each particular control chosen.
- In all cases manufacturer equipment schematics will take precedence over HeatLink® electrical schematics.
- All wiring as per applicable electrical codes!

StatLink® Controls Activating Circuits plus SnowMelt. Controller

July 11, 2008 - **ELECT 5.4b**

