

www.heatlinkgroup.com

Boiler, IFHWH, & Floor Heating Indoor/Outdoor Controller

November 9, 2004 - **ELECT 5.7**

Application: **Automatic indoor/outdoor controller modulating boiler supply water temp., low temp. floor heating, & domestic hot water (with optional DHW priority).**

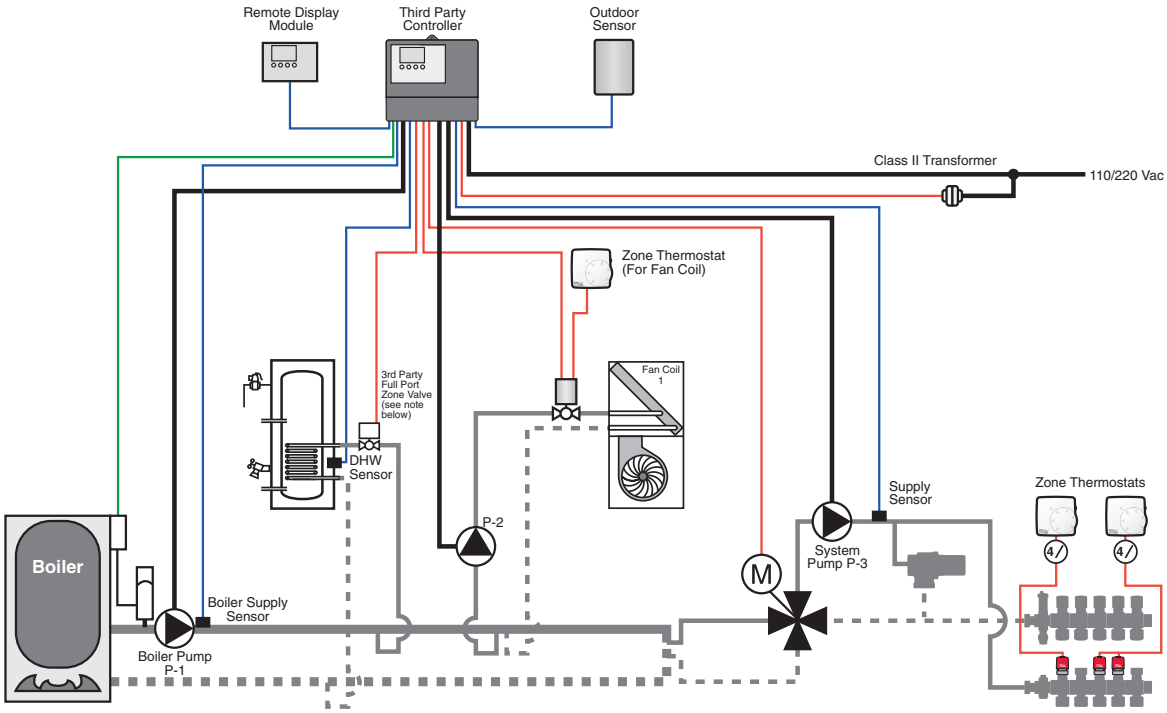

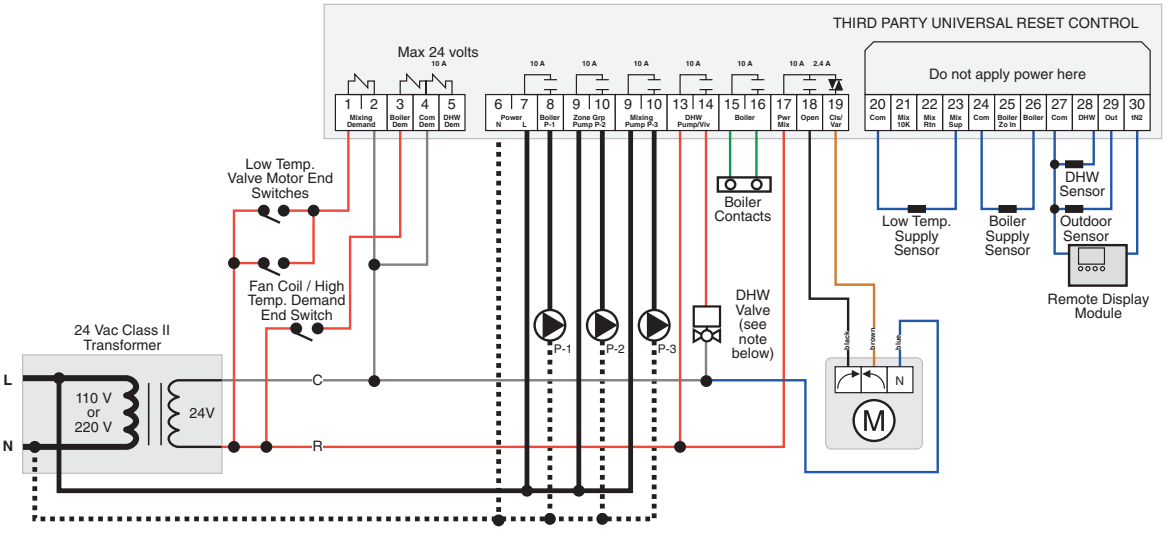

Note: For DHW tank use thrid party full port zone valve. See ELECT 4.2 for typical wiring

Note:

- Drawings are for HeatLink® suggested electrical diagrams only! User must determine if electrical diagram will work for their particular application. User must also confirm all HeatLink® diagrams with manufacturer diagrams of each particular control chosen.
- In all cases manufacturer equipment diagrams will take precedence over HeatLink® electrical diagrams.
- All wiring as per applicable electrical codes!