

www.heatlinkgroup.com


Single Room/Zone Thermostat Activating Low Temperature Circuit

April 20, 2006 - **ELECT 6.2**

Application: **Zone thermostat activates primary and secondary pumps for the low temperature manifold circuit either through a relay or directly with a line voltage thermostat.**
Primary Circuit c/w isolating heat exchanger and primary (P-2) and secondary (P-1) pumps.

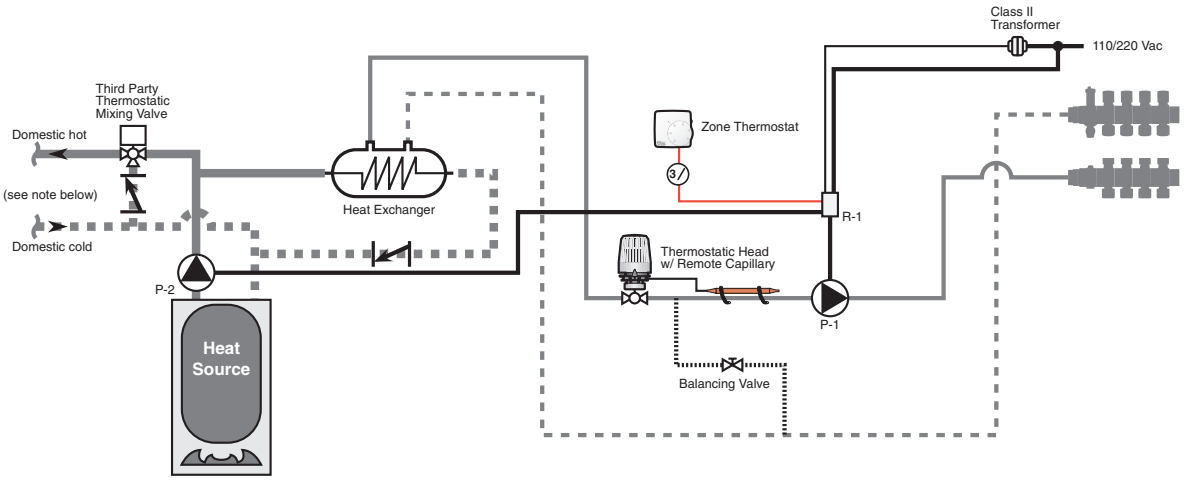

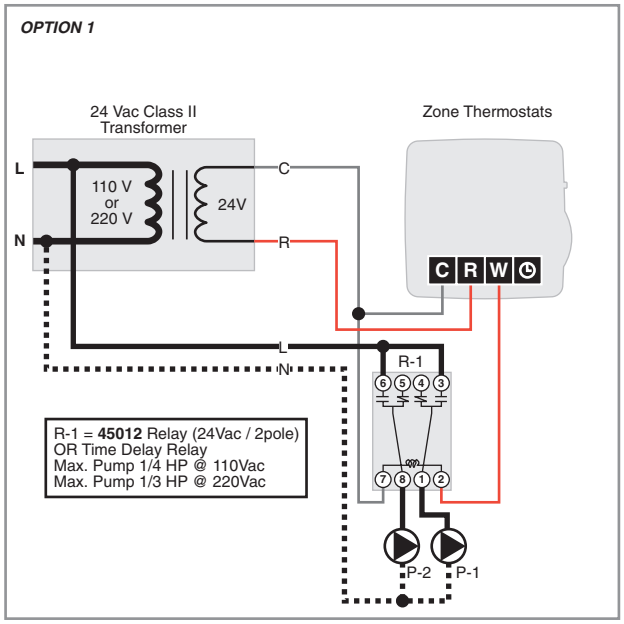

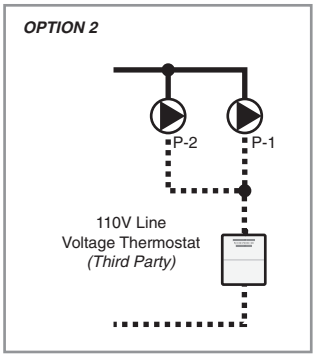

Note: Optional primary pump & heat exchanger may not be required depending on type of heat source being utilized.

Note: Optional primary pump & heat exchanger may not be required depending on type of heat source being utilized.

Note:

- Drawings are for HeatLink® suggested electrical diagrams only! User must determine if electrical diagram will work for their particular application. User must also confirm all HeatLink® diagrams with manufacturer diagrams of each particular control chosen.
- In all cases manufacturer equipment diagrams will take precedence over HeatLink® electrical diagrams.
- All wiring as per applicable electrical codes!