

www.heatlinkgroup.com

StatLink® Controls Activating Low Temperature Circuit

July 11, 2008 - **ELECT 6.3**

Application: **StatLink® controls activating individual actuators and valves for the low temperature manifold circuit.**
Boiler c/w system pump (P-1) & primary pump (P-2).

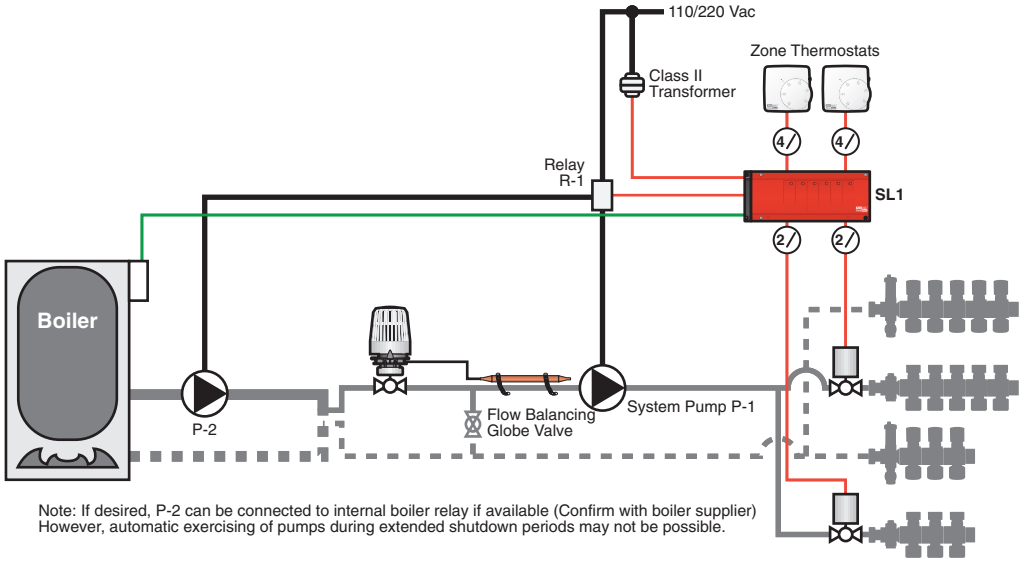

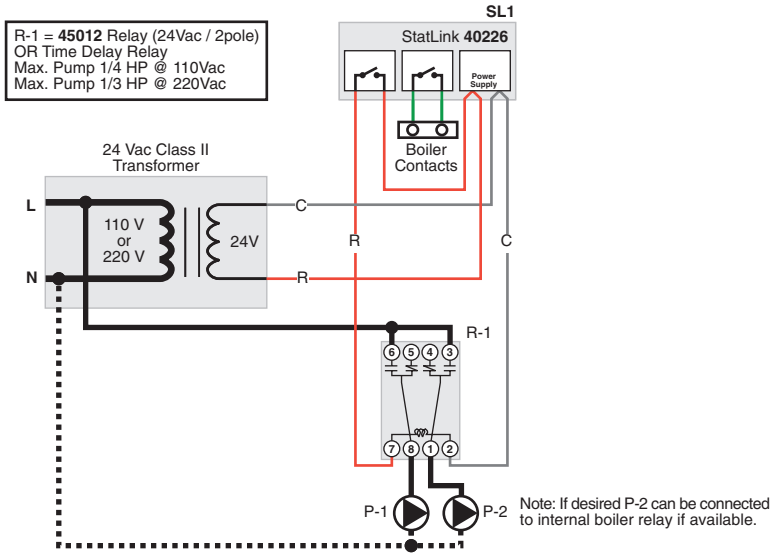

Note:

- Drawings are for HeatLink® suggested electrical diagrams only! User must determine if electrical diagram will work for their particular application. User must also confirm all HeatLink® diagrams with manufacturer diagrams of each particular control chosen.
- In all cases manufacturer equipment diagrams will take precedence over HeatLink® electrical diagrams.
- All wiring as per applicable electrical codes!