

www.heatlinkgroup.com

# Injection Mixing Control Activating Low Temperature Circuit

July 11, 2008 - **ELECT 6.4**

***Application:*** **Injection mixing control activating secondary pump for the low temperature manifold circuit. Boiler c/w system pump (P-1), and primary pump (P-2).**

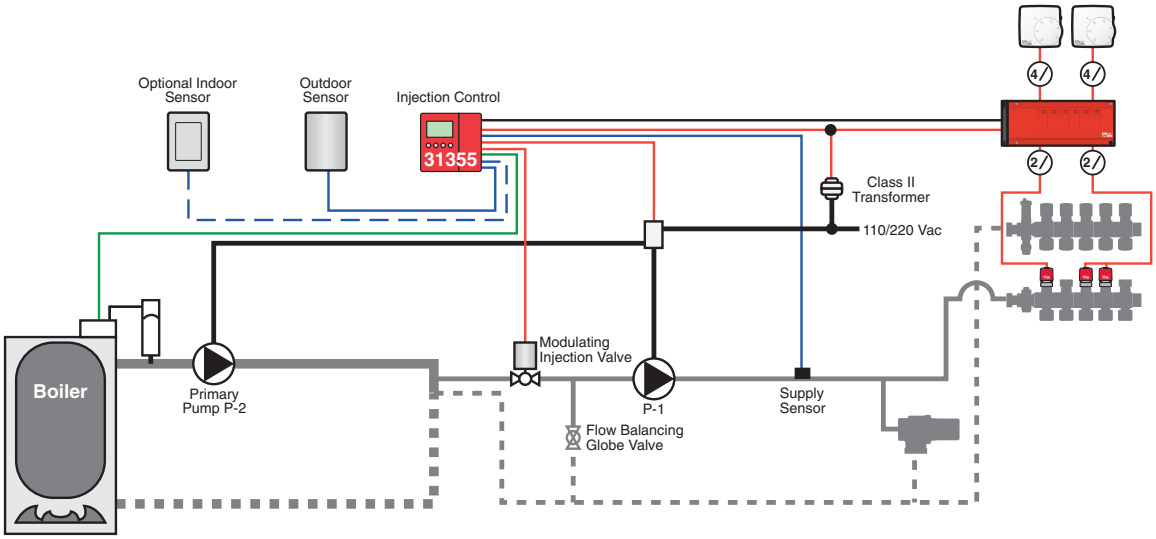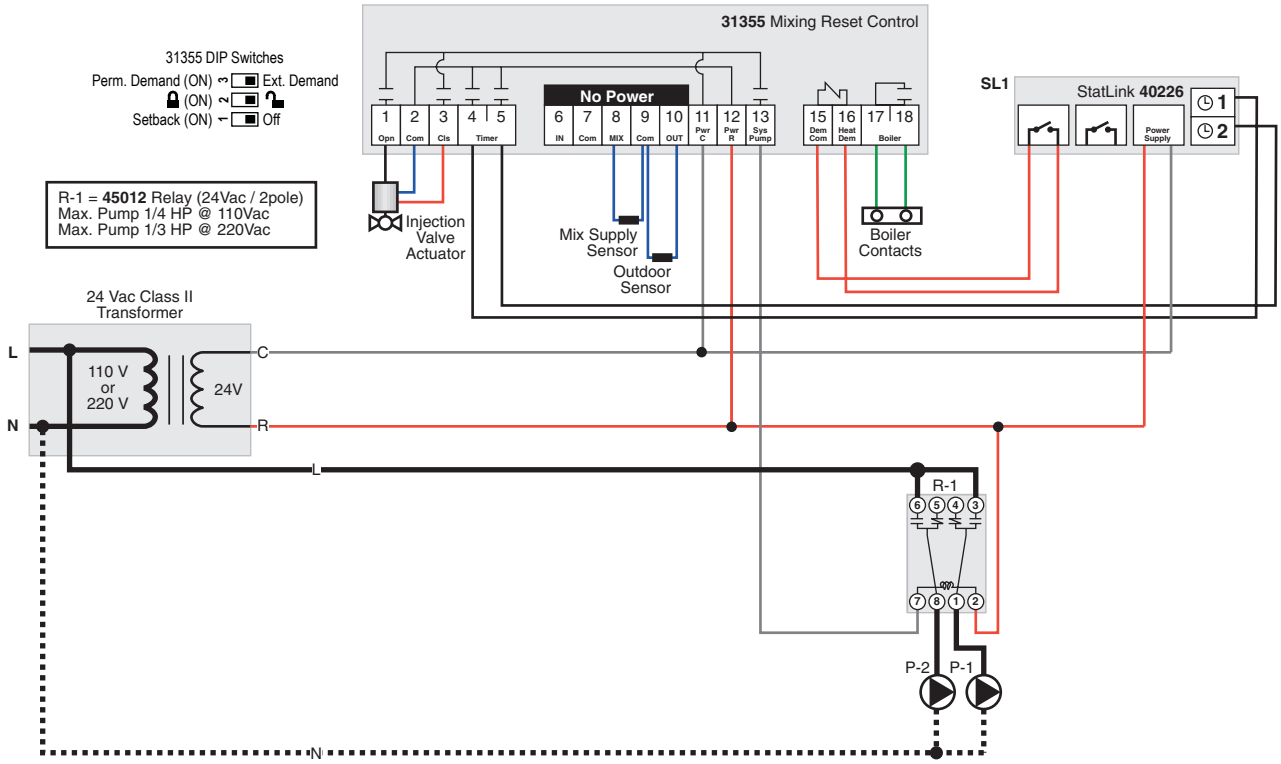


**Note:**

- Drawings are for HeatLink® suggested electrical diagrams only! User must determine if electrical diagram will work for their particular application. User must also confirm all HeatLink® diagrams with manufacturer diagrams of each particular control chosen.
- In all cases manufacturer equipment diagrams will take precedence over HeatLink® electrical diagrams.
- All wiring as per applicable electrical codes!
- If only the indoor/floor sensor is used without thermostats or StatLink® then power is required at terminals 1 & 2.