

www.heatlinkgroup.com

Injection Mixing Control Activating Low Temperature Floor Warming Circuit

July 17, 2008 - **ELECT 6.8**

Application: **Injection Mixing Control maintaining setpoint for the low temperature floor warming or subsoil frost protection manifold circuit.**
High mass boiler c/w primary (P-2) and system (P-1) pumps.

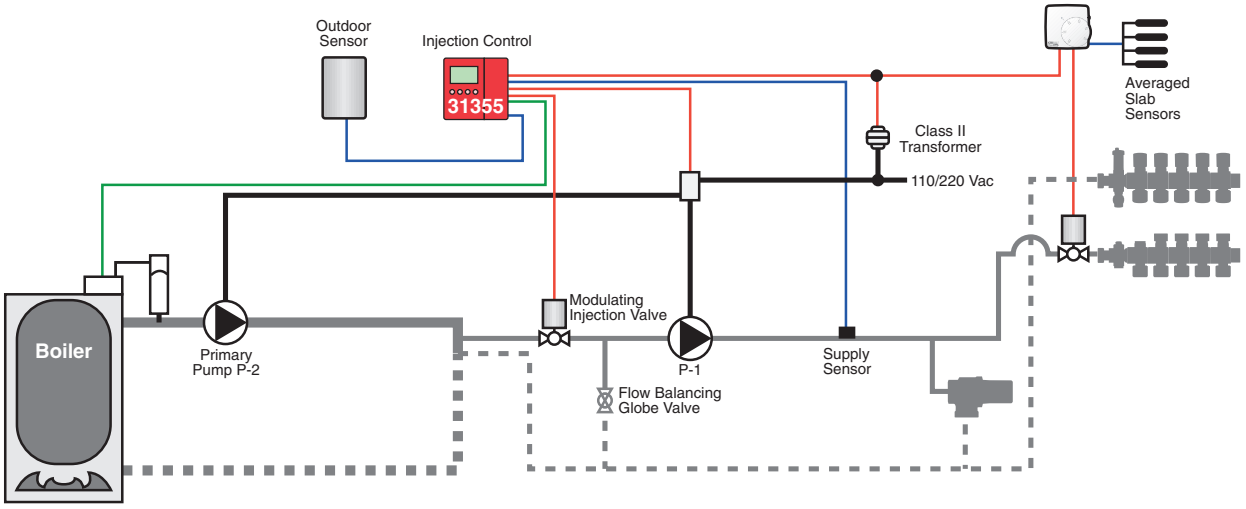

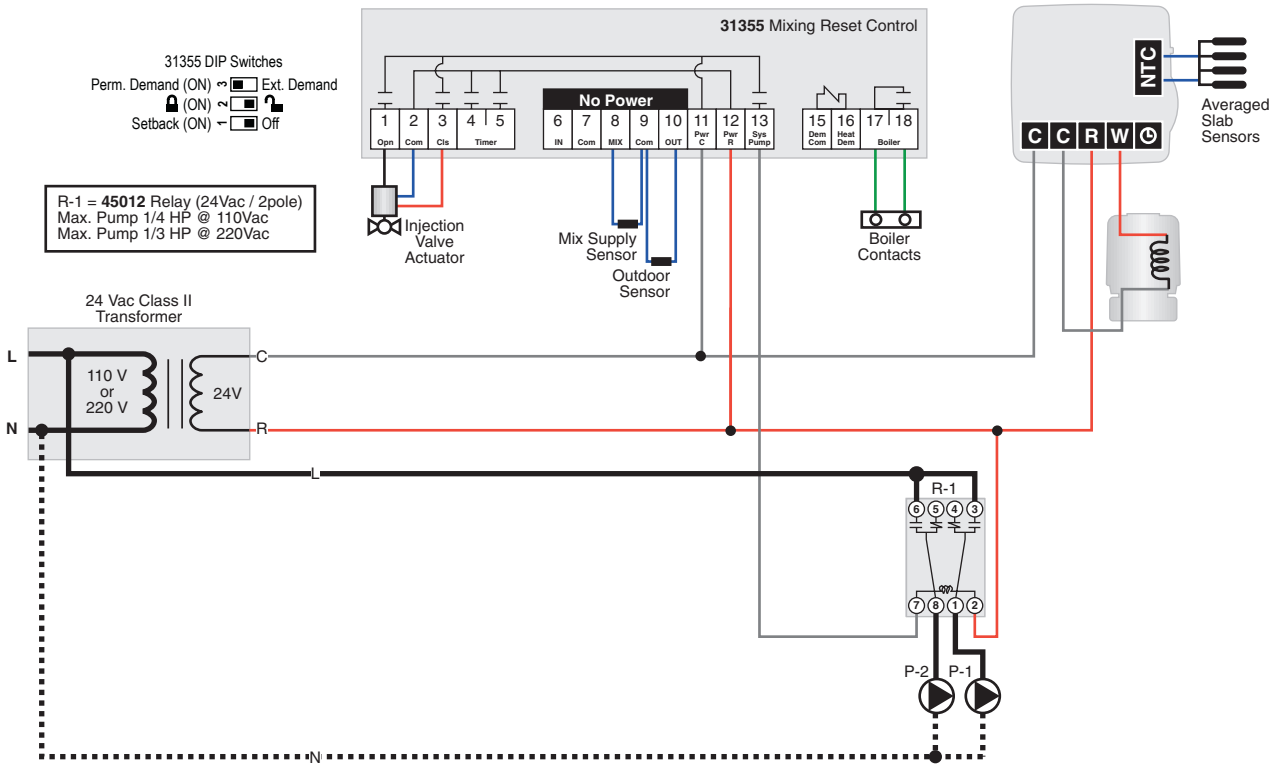

Note:

- Drawings are for HeatLink® suggested electrical diagrams only! User must determine if electrical diagram will work for their particular application. User must also confirm all HeatLink® diagrams with manufacturer diagrams of each particular control chosen.
- In all cases manufacturer equipment diagrams will take precedence over HeatLink® electrical diagrams.
- All wiring as per applicable electrical codes!