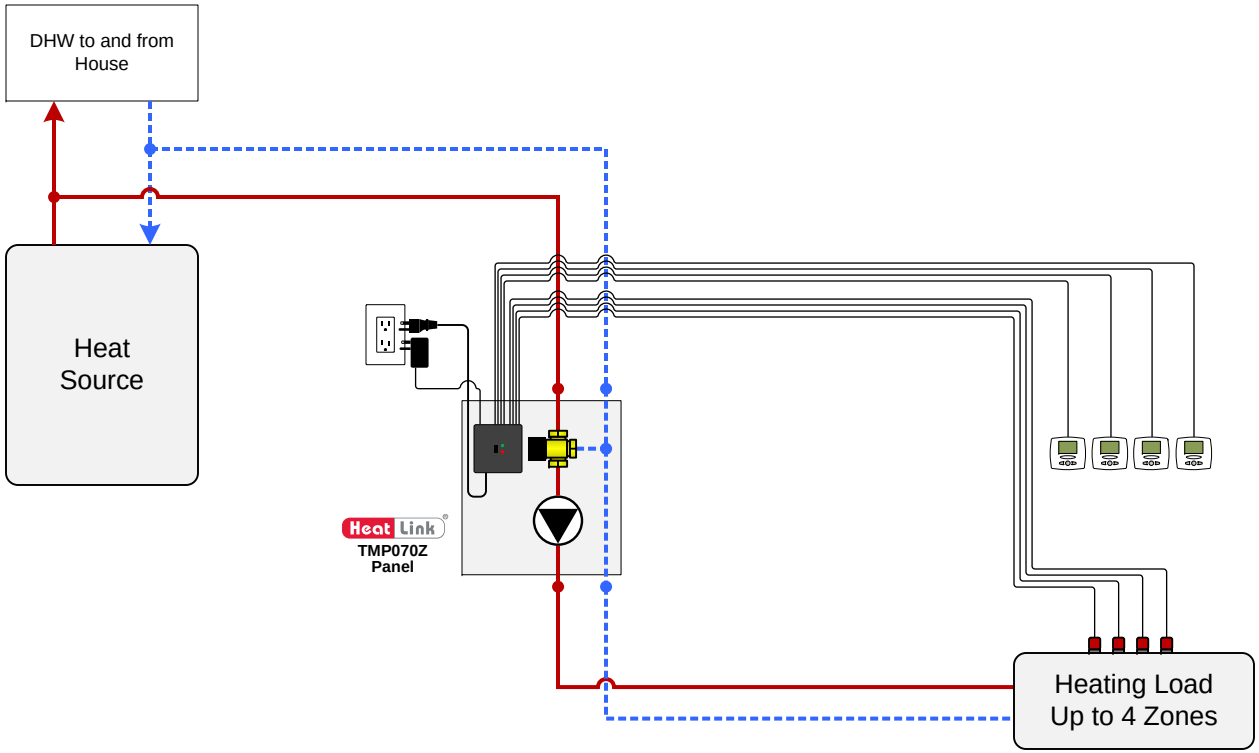



Heat Link®
www.heatlinkgroup.com
1-866-661-5332

**Notes:**
- Drawings are for HeatLink suggested system layout only! User must determine if system layout will work for their particular application.
- Air vents, expansion tanks, pressure relief valves, etc. for heat source as per local codes.
- Use isolation ball valves for all circuits and components.
- Local codes, regulations, and authorities have final jurisdiction.

*Heat Source:* Generic
*Panel(s):* TMP070Z
*Heat Load(s):* Generic – Up to 4 Zones

*Date:* 2013-05-23

*Schematic #:* **SCH-TMPZ-M001**
*Rough-in wiring see:* SCH-MRIB-R006
*Wiring detail see:* SCH-TMPZ-E001