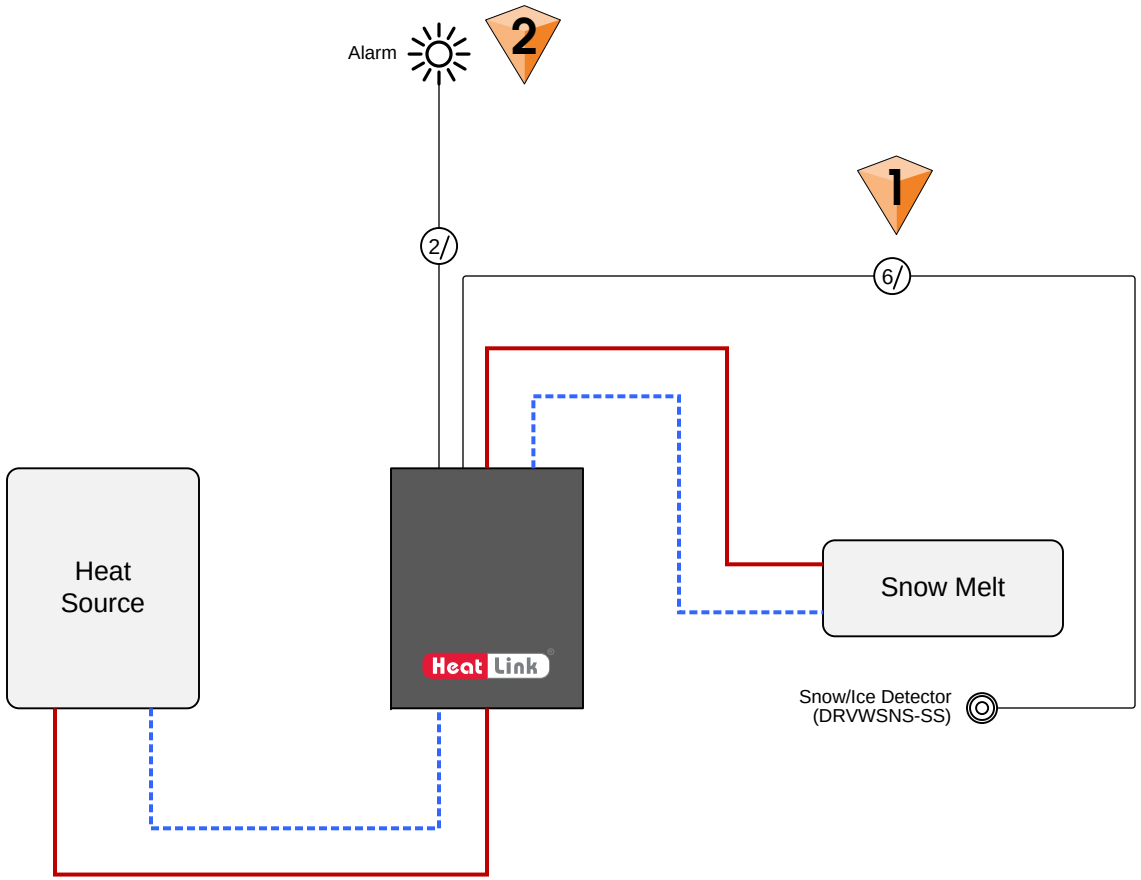


1 **Snow/Ice Detector**
Standard 6-wire to be run from heated slab at least three feet from edge of the heating area back to the mechanical room. Run wires within a conduit for future access if necessary.

2 **Alarm (optional)**
Standard 2-wire to be run from remote location back to the mechanical room.

Heat Link®
www.heatlinkgroup.com
1-866-661-5332

Notes:
- Drawings are for HeatLink suggested electrical schematics only! User must determine if electrical schematic will work for their particular application. User must also confirm all HeatLink schematics with manufacturer schematics of each particular control chosen.
- In all cases manufacturer equipment schematics will take precedence over HeatLink electrical schematics.
- Local codes, regulations, and authorities have final jurisdiction.

Application: Rough-in Wiring for SS SMP Panels

Date: 2013-05-24

Schematic #: **SCH-SMP-R002**

Rough-in wiring see: