www.heatlinkgroup.com

Thermostatic Head with Capillary
Submittal - Page 1 of 1

Job or Customer :	
Location :	
Engineer :	
❑ Complies with Spec ❑ Alternate	Notes :
Contractor :	
HeatLink Rep :	
Submitted By :	Date :
Approved By :	Date :
P.O. Number :	Date :

Description
Used as injection control for HeatLink® zone valves. Senses 0.4°F (0.2°C) supply water change. Takes 15 minutes to close from full open.


Technical Data
Temperature Setting Range:..... 96-150°F (36-66°C)
Sensor: ..... Liquid filled contact sensor

Standards / Listings
n/a

Installation
Installation must follow all of HeatLink's instructions and guidelines.

Related Documents
• L657090 Thermostatic Head with Capillary Installation Instructions
• Component Warranty

		Dimensions				
Qty	**Stk. #**	**A**	**B**	**C**	**D**	**Weight**
	57094	2" (53 mm)	3-1/2 to 3-5/8" (88 to 93 mm)	6-1/2' (2 m)	6-7/16" (167 mm)	0.65 lb 0.265 kg

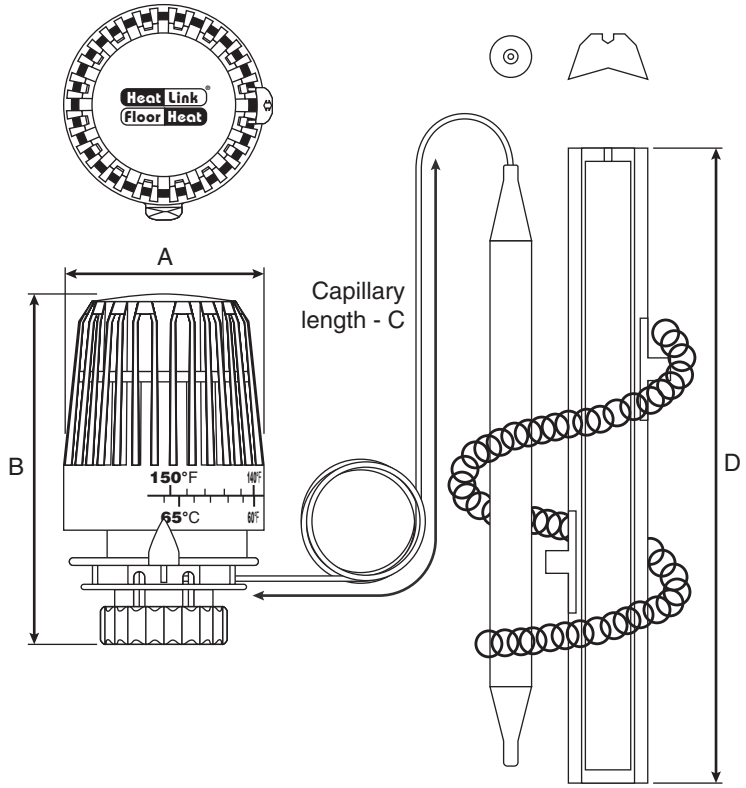

Head Office: 4603E - 13th Street NE, Calgary, AB, T2E 6M3
Mississauga Office: 1555 Bonhill Road, Unit #7, Mississauga, ON, L5T 1Y5
Grand Rapids Office: 1000 - 100th Street SW, Suite B, Byron Center, MI, 49315
Toll Free: 1-800-661-5332 • Canada Fax: 1-866-450-1155 • USA Fax: 1-800-869-6098

©2009 HeatLink Group Inc.

This page is intentionally blank.